


## SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to SS-EN ISO 354 and SS 25269

CLIENT: ABSTRACTA  
 OBJECT: dB Floor Screen  
 Size [mm]:  $w = 800$     $h = 1500$     $t = 30$

1/3 octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)	
	1/3 octave band	Octave band
50	0,11	
63	0,29	0,2
80	0,17	
100	0,22	
125	0,26	0,3
160	0,34	
200	0,69	
250	0,71	0,7
315	0,83	
400	1,02	
500	1,14	1,2
630	1,34	
800	1,44	
1000	1,51	1,5
1250	1,55	
1600	1,56	
2000	1,54	1,5
2500	1,31	
3150	1,49	
4000	1,53	1,6
5000	1,78	
$N_{10} =$		8,6

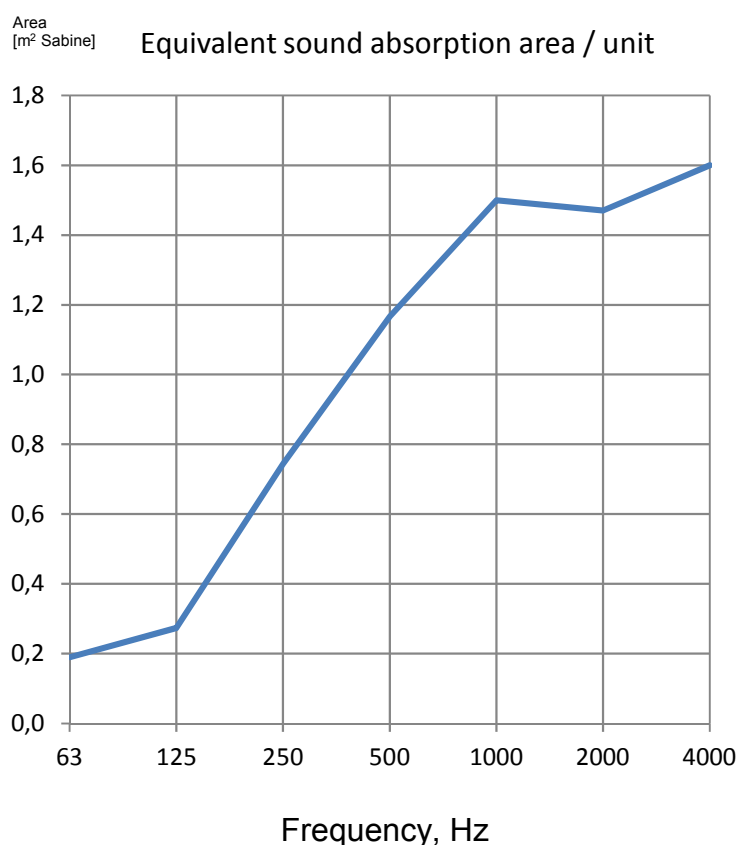

### CONDITIONS

Date of test: 2018-01-23      Object volume: 0,04 m<sup>3</sup>  
 Date: 2018-05-03      Rev. room volume: 200 m<sup>3</sup>

Test report: **17-360-M1 date 2018-01-23 (Akustikverkstan AB, Sweden)**

Signature: Delphine Bard